

Number	18-004115-PR01 (NW 3-E03-020310-en-03)
Owner	MOLL bauökologische Produkte GmbH Rheintalstr. 35-43 68723 Schwetzingen Germany
Product	External joint sealing system between window and building structure
Designation	Shipping name: Aerosana Visconn 1AR01106
Details	Masonry Reinforced concrete, plastered in reveal; window PVC-window, 1,230 mm x 1,480 mm with glass configuration $\underline{4} / 16 / \underline{4}$ , centered in the reveal; fixing screws, lateral and at top, fixing distance $\leq 700$ mm; lateral securing transverse spacer blockings; load transmission spacer blockings at bottom; joint infill fiber insulation Isolena SDFB03

#### Special features

#### Result

Valuation of joint-properties according to ift-guideline MO-01/1:2007-01 - section 5.4 (detail results on page 2)



**Requirement: fulfilled**

#### Basis \*)


ift-Richtlinie MO-01/1 2007-01  
) and corresponding national versions  
e.g. DIN EN)

Test report: 18-004115-PR01 PB  
1-E03-020310-de-02

Replaces ift-Nachweis:

18-004115-PR01 NW 3-E03-  
020310-en-02 dated 21.08.2019

#### Representation

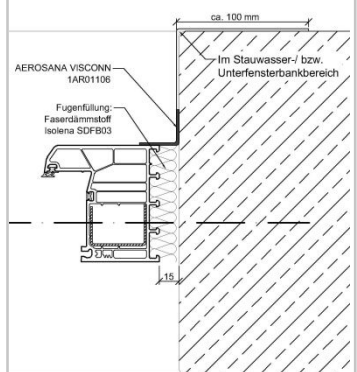

#### Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

#### Validity

There is no time limit.

When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and results given relate solely to the tested and described specimen. This test does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

#### Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim

21.10.2019



Thomas Stefan, Dipl.-Ing. (FH)  
Head of Testing Department  
Building Component Testing



Thomas Krichbaumer  
Deputy Head of Testing Department  
Building Component Testing

Identity-Check



[www.ift-rosenheim.de/ift-geprueft](http://www.ift-rosenheim.de/ift-geprueft)  
ID: 8D4-984E1

## Summary of results

Assessment according to ift-Guideline MO-01/1, section	Tested performance characteristics	Test results
5.4	Receiving inspection according to ift-Guideline MO-01/1:2007-01	Requirements fulfilled
	Watertightness in new condition following EN 1027:2016-03	No water penetration at up to 600 Pa
	Thermal cycling according to ift-Guideline MO-01/1:2007-01	Requirements fulfilled
	Mechanical durability following EN 1191:2000-02	Requirements fulfilled
	Resistance to wind load - alternating positive and negative pressures following EN 12211:2016-03	Requirements fulfilled
	Watertightness after load tests following EN 1027:2016-03	No water penetration at up to 600 Pa
	Dismantling and inspection according to ift-Guideline MO-01/1:2007-01	Requirements fulfilled

**The test specimen fulfils the requirements of ift-Guideline MO-01-1:2007-01, section 5.4 within the scope:  
 External**